


[illegible]


DATE: 19 MAR 03

SCALE: NTS

ENV-1

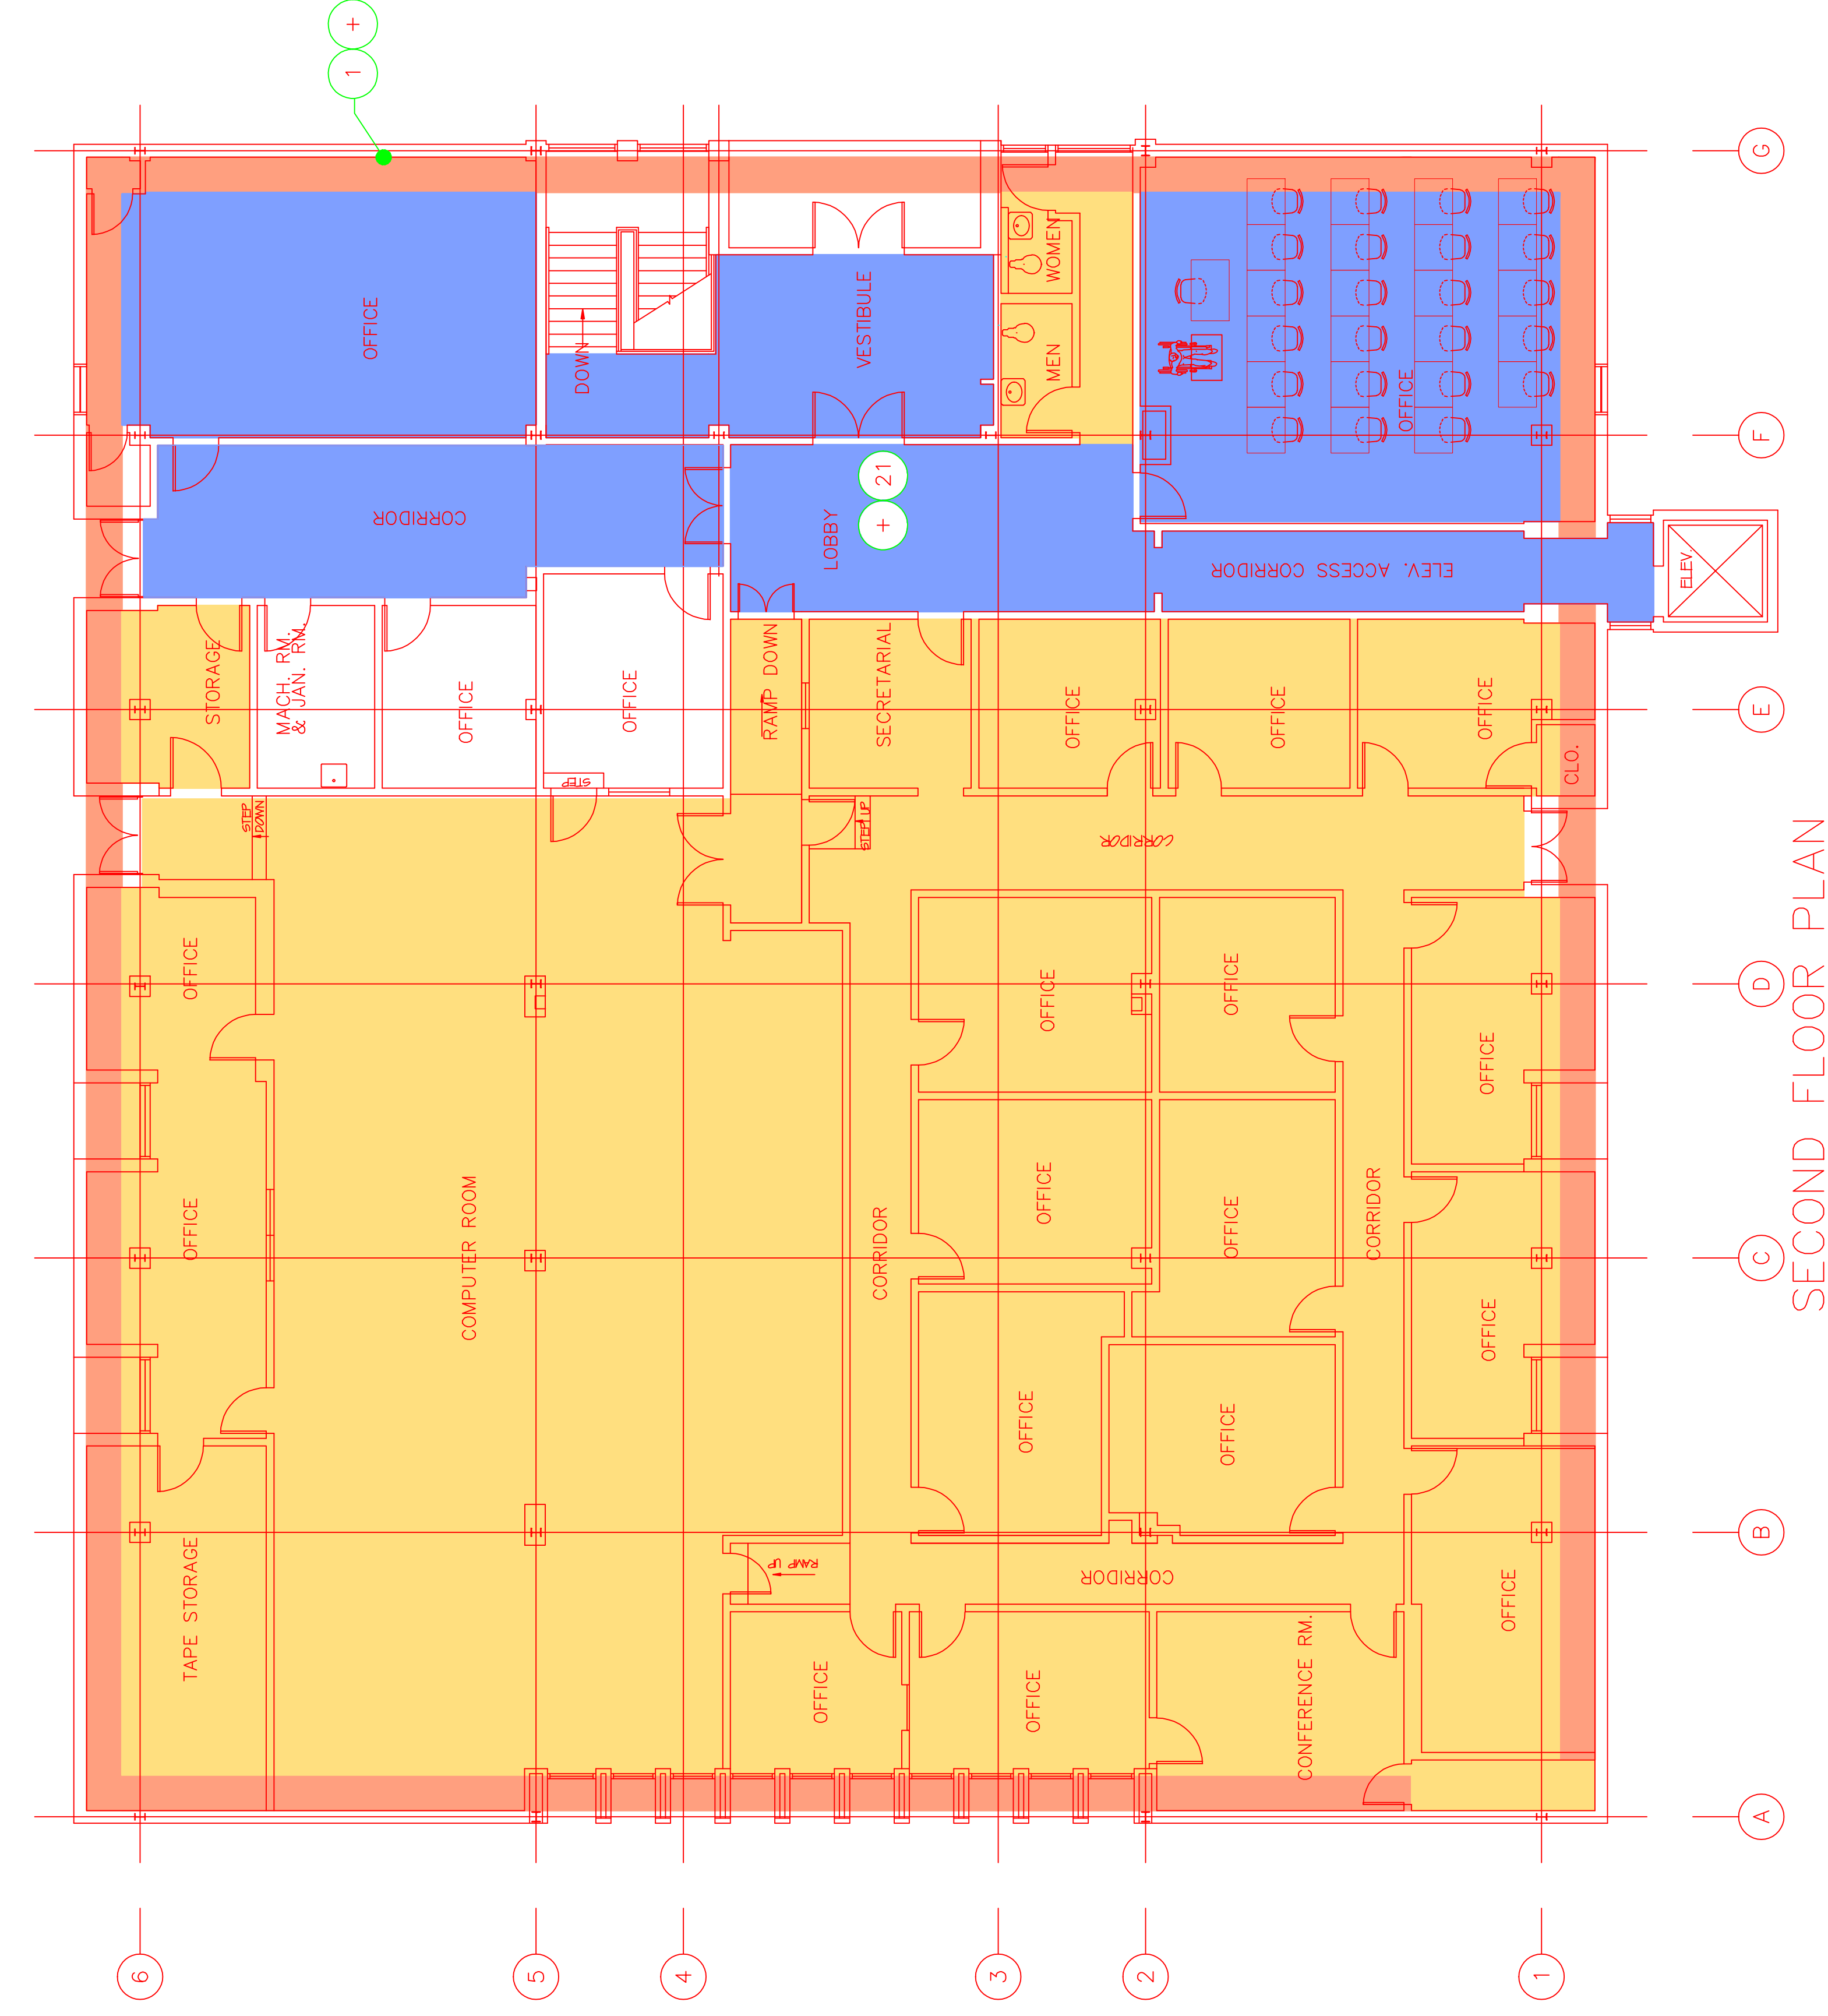

SECOND FLOOR PLAN

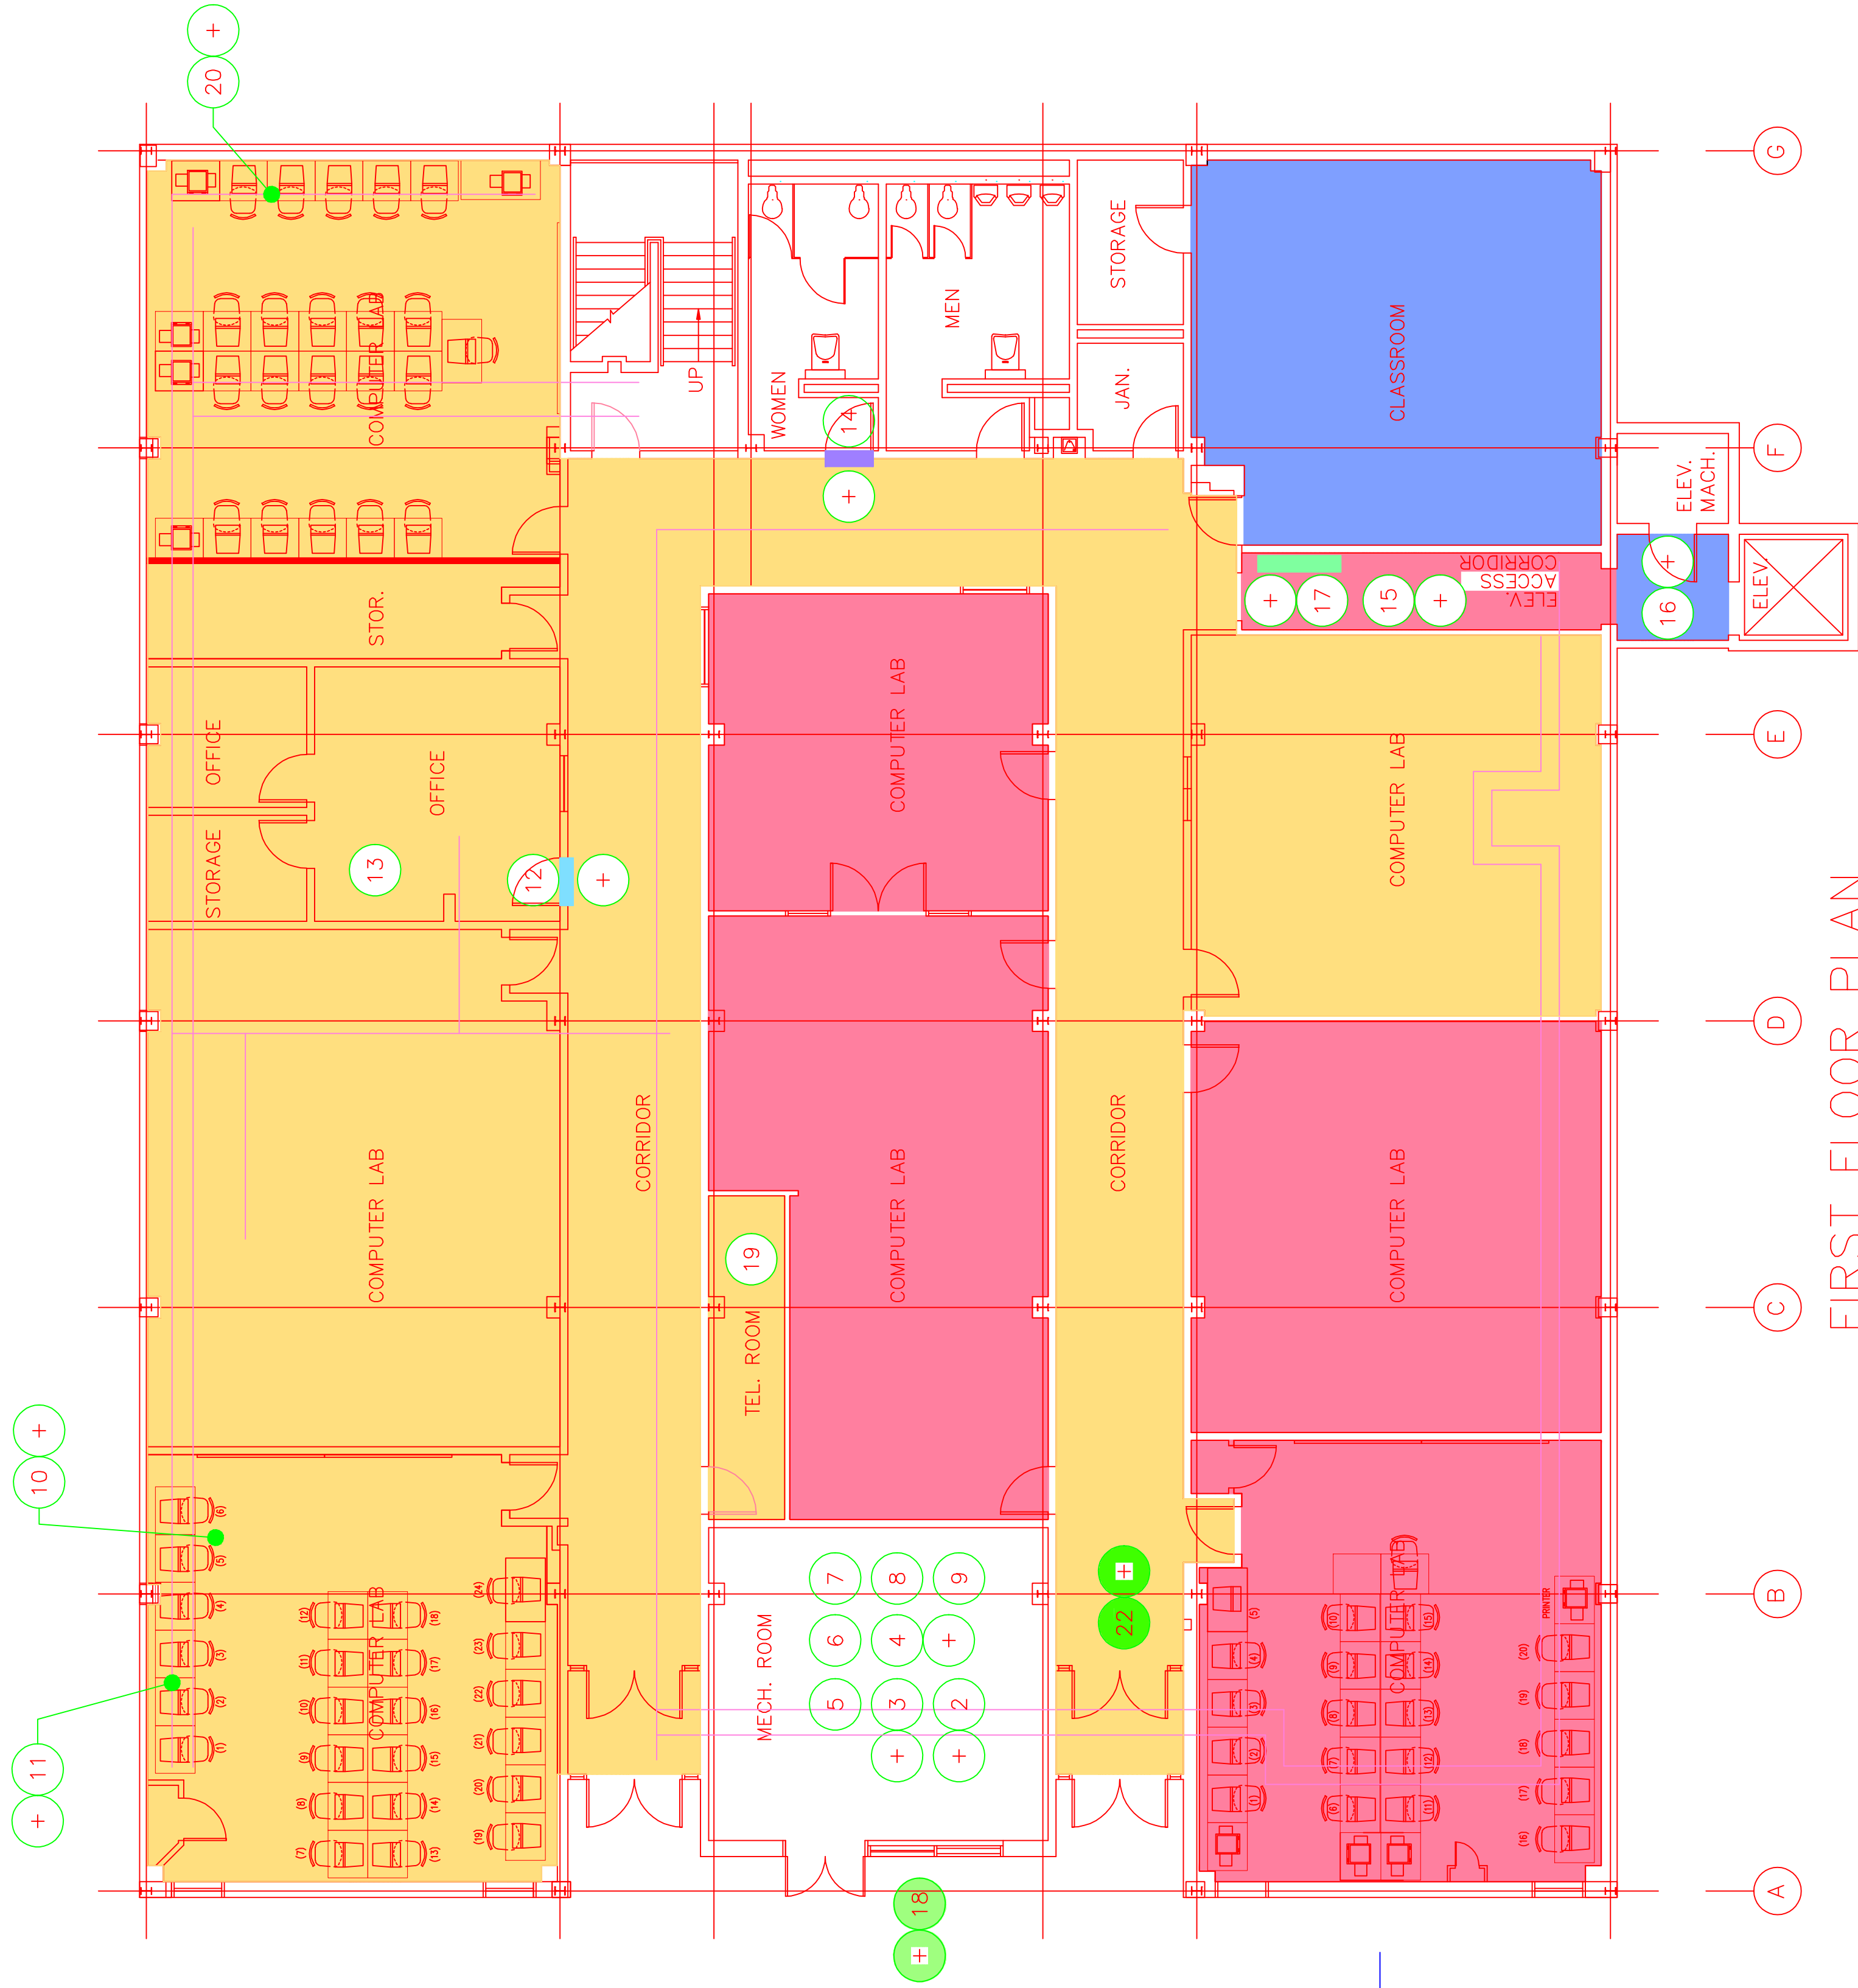

FIRST FLOOR PLAN

LEGEND:

- = SAMPLE NUMBER/LOCATION
- = POSITIVE ACM RESULT
- = FIRE DOORS

- | | |
|---|---|
|  | = SPRAY-ON FIREPROOFING INSULATION, FRIABLE, UP TO 50% AMOSITE (1,500SF) |
|  | = WINDOW CAULKING ON PERIMETER EXTERIOR WINDOWS, NON-FRIABLE, 4.0% CHRYSOTILE (30 WINDOWS) (NOT SHOWN) |
|  | = 49± FITTINGS TSI, NON-FRIABLE, 3.0% CHRYSOTILE, 2.0% AMOSITE |
|  | = 9"x9" TAN FLOOR TILE, NON-FRIABLE, 6.7% CHRYSOTILE, MASTIC 7.0% CHRYSOTILE (15000SF) |
|  | = BLACK MASTIC ON PIPE INSULATION, NON-FRIABLE, 15.0% CHRYSOTILE (ON 80 PIPE FITTINGS AND EVERY4 LF ALONG PIPE RUN) |
|  | = FLOOR MASTIC, NON-FRIABLE, 4.4% CHRYSOTILE, FLOOR TILES NEGATIVE (12SF) |
|  | = 9"x9" GREY W/ BLACK & WHITE STREAK FLOOR TILE, NON-FRIABLE, 8.7% CHRYSOTILE, MASTIC 10.0% CHRYSOTILE (5SF) |
|  | = 12"x12" TAN W/ DARK BROWN SPECK FLOOR TILE, NON-FRIABLE, 7.7% CHRYSOTILE, MASTIC 8.0% CHRYSOTILE (2000SF) |
|  | = 12"x12" LT TAN W/ BROWN SPECK FLOOR TILE, NON-FRIABLE, 7.7% CHRYSOTILE, MASTIC NEGATIVE (2500SF) |
|  | = 9"x9" DARK BROWN FLOOR TILE, NON-FRIABLE, 6.4% CHRYSOTILE, MASTIC POSITIVE (10SF) |
|  | = OUTSIDE MECH RM, 15± TSI-PIPE FITTING INSULATION, EXTERIOR FRIABLE, 3.0% AMOSITE |
|  | = 12± WHITE MASTIC ON FITTINGS, NON-FRIABLE, 4.0% CHRYSOTILE |
|  | = WHITE HVAC DUCT INSULATION JOINT COMPOUND THROUGHOUT SECOND FLOOR, NON-FRIABLE, 10.0% CHRYSOTILE |
|  | = SPRAY-ON FIRE PROOFING INSULATION OVERSPRAY, FRIABLE, 50.0% AMOSITE |

