


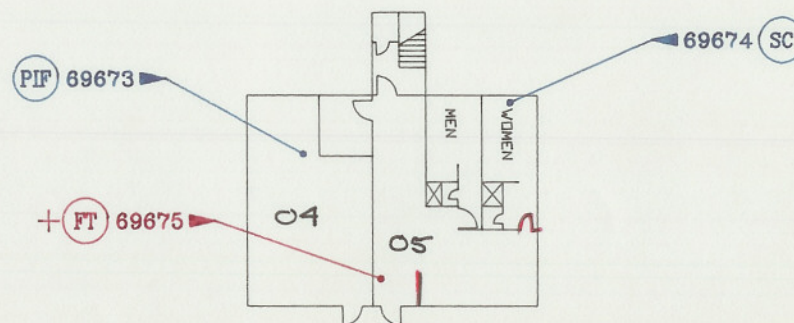

LEGEND

BASEMENT

- (FT) FLOOR TILE
- (PIF) PIPE FITTING INSULATION
- (SC) SMOOTH CEILING
- (+) DENOTES POSITIVE RESULTS

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
TAKOMA PARK CAMPUS
ASBESTOS INVENTORY


APPROVED:

SAMPLE LOCATIONS
BUILDING: SCISOUTH

SCALE: 1" = 30'

DATE: 03/18/91

DRAWING NO.: SS0-BS

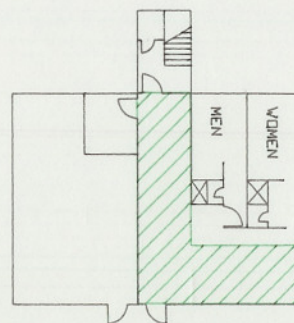

BASEMENT
AREAS POSITIVE FOR FLOOR TILE
AND MASTIC (ASSUMED)

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
 TAKOMA PARK CAMPUS
 ASBESTOS INVENTORY


APPROVED:

SAMPLE LOCATIONS
 BUILDING: SCISOUTH

SCALE: 1" = 30'

DATE: 03/18/91

DRAWING NO.: SSO-BFT

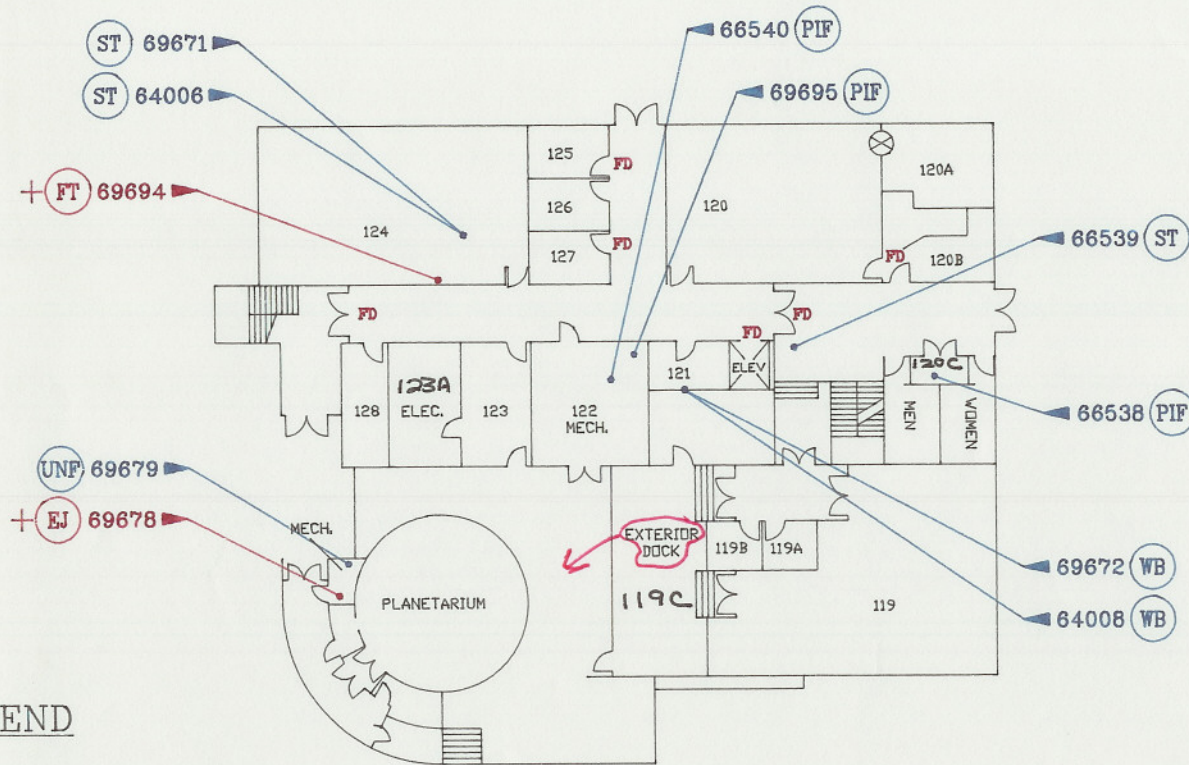

LEGEND

- (EJ) FLEXIBLE DUCT CONNECTOR
- (FT) FLOOR TILE
- (PIF) PIPE FITTING INSULATION
- (ST) SUSPENDED CEILING TILES
- (UNF) UNKNOWN FUNCTION PIPE INSULATION
- (WB) WALL BOARD
- (+) DENOTES POSITIVE RESULTS
- FD FIRE DOOR (ASSUMED TO CONTAIN ASBESTOS)

FIRST FLOOR

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
TAKOMA PARK CAMPUS
ASBESTOS INVENTORY


APPROVED:

SAMPLE LOCATIONS
BUILDING: SCISOUTH

SCALE: 1" = 30'


DATE: 03/18/91

DRAWING NO.: SSO-1S

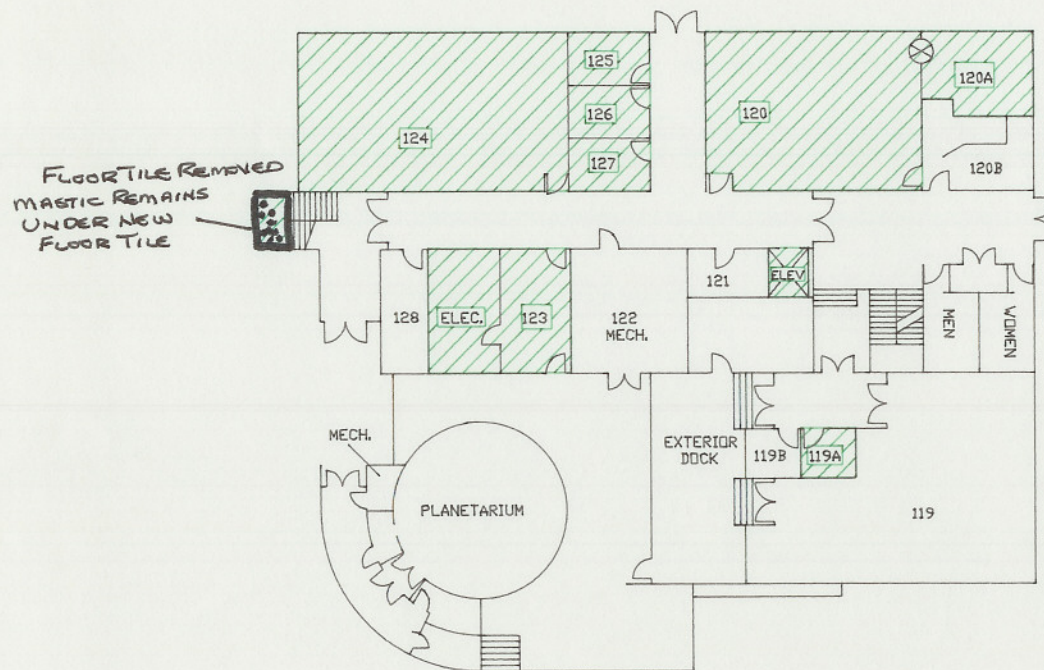


FIRST FLOOR
AREAS POSITIVE FOR FLOOR TILE
AND MASTIC (ASSUMED)

DYNAMAC CORPORATION	MONTGOMERY COLLEGE TAKOMA PARK CAMPUS ASBESTOS INVENTORY
APPROVED:	SAMPLE LOCATIONS BUILDING: SCISOUTH
SCALE: 1" = 30'	DATE: 03/18/91
	DRAWING NO.: SSO-1FT



		MONTGOMERY COLLEGE TAKOMA PARK CAMPUS ASBESTOS INVENTORY	
APPROVED:		SAMPLE LOCATIONS BUILDING: SCISOUTH	
DATE: 03/18/91		DRAWING NO.: SSO-1EJ	

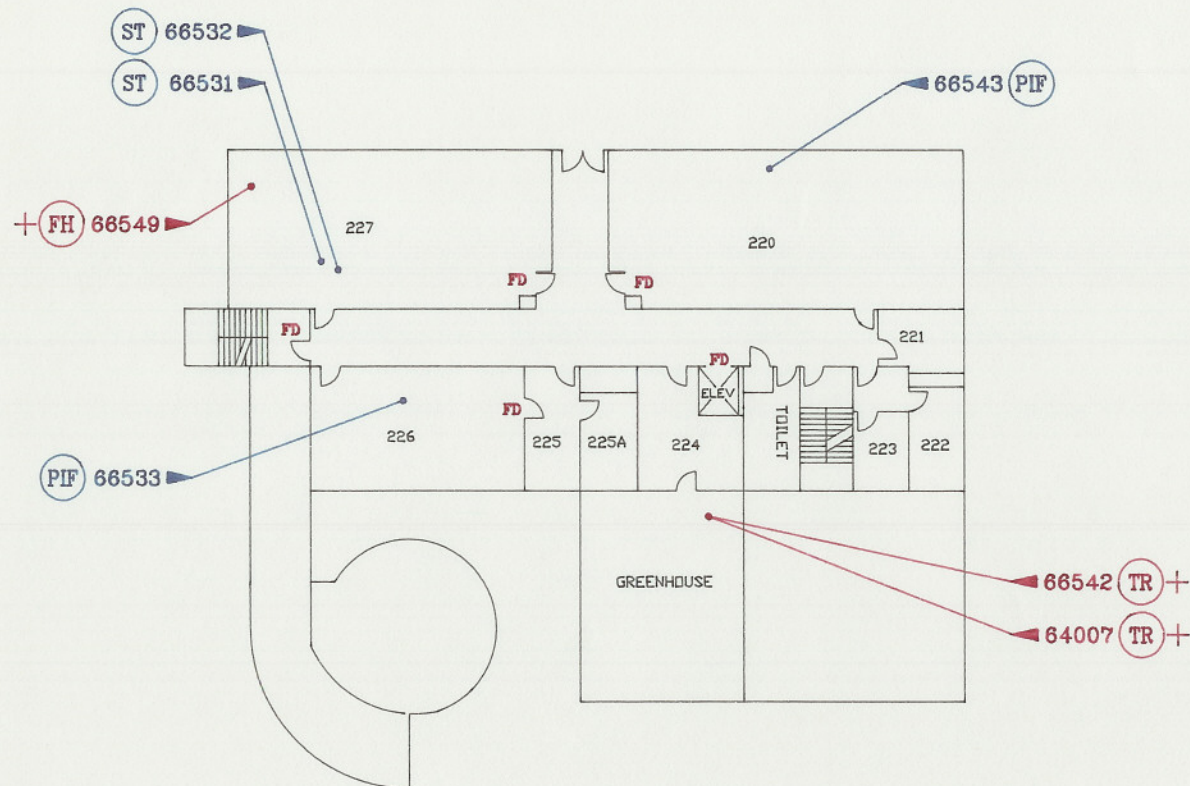

LEGEND

- (FH) FUME HOODS/CABINETS
- (PIF) PIPE FITTING INSULATION
- (ST) SUSPENDED CEILING TILES
- (TR) TRANSITE
- (+) DENOTES POSITIVE RESULTS
- FD FIRE DOOR (ASSUMED TO CONTAIN ASBESTOS)

SECOND FLOOR

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
TAKOMA PARK CAMPUS
ASBESTOS INVENTORY

APPROVED:

SAMPLE LOCATIONS
BUILDING: SCISOUTH


SCALE: 1" = 30"

DATE: 03/18/91

DRAWING NO.: SSO-2S

FLOOR TILE & MASTIC
REMOVED BY UAS
AUTOMATION
08/06/98

FLOOR TILE REMOVED/REPLACED
12/20/93. MASTIC REMAINS UNDER
NEW FLOOR TILE

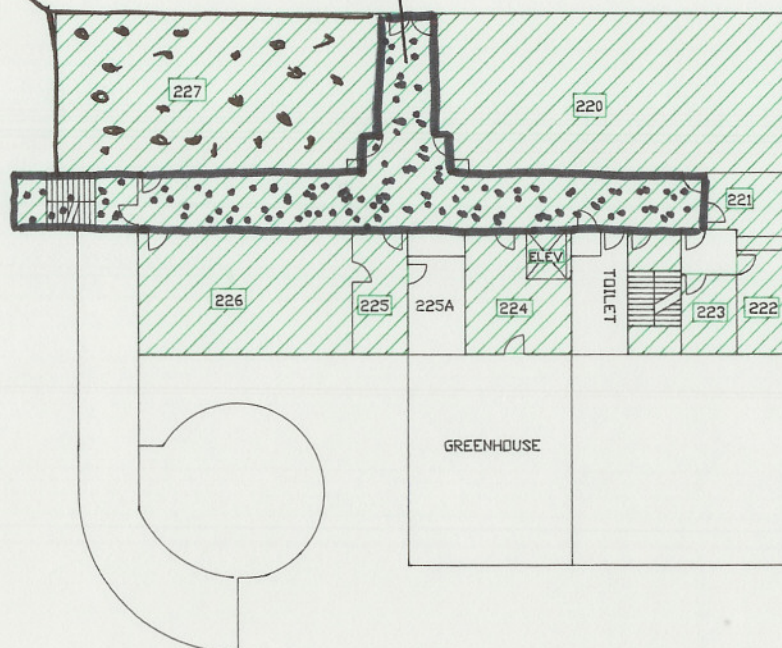

SECOND FLOOR
AREAS POSITIVE FOR FLOOR TILE
AND MASTIC (ASSUMED)

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
TAKOMA PARK CAMPUS
ASBESTOS INVENTORY


APPROVED:

SAMPLE LOCATIONS
BUILDING: SCISOUTH

SCALE: 1" = 30'

DATE: 03/18/91


DRAWING NO.: SSO-2FT

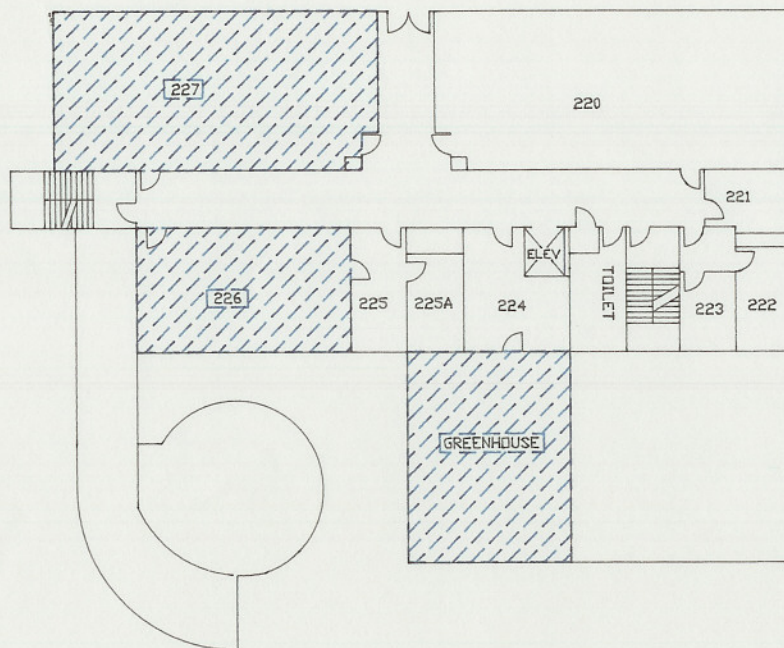

SECOND FLOOR
AREAS POSITIVE FOR TRANSITE IN FUME HOODS
& GREENHOUSE PLANTER'S STAND

DYNAMAC CORPORATION	MONTGOMERY COLLEGE TAKOMA PARK CAMPUS ASBESTOS INVENTORY
APPROVED:	SAMPLE LOCATIONS BUILDING: SCISOUTH
DATE: 03/18/91	DRAWING NO.: SS0-2TR

SCALE: 1" = 30'

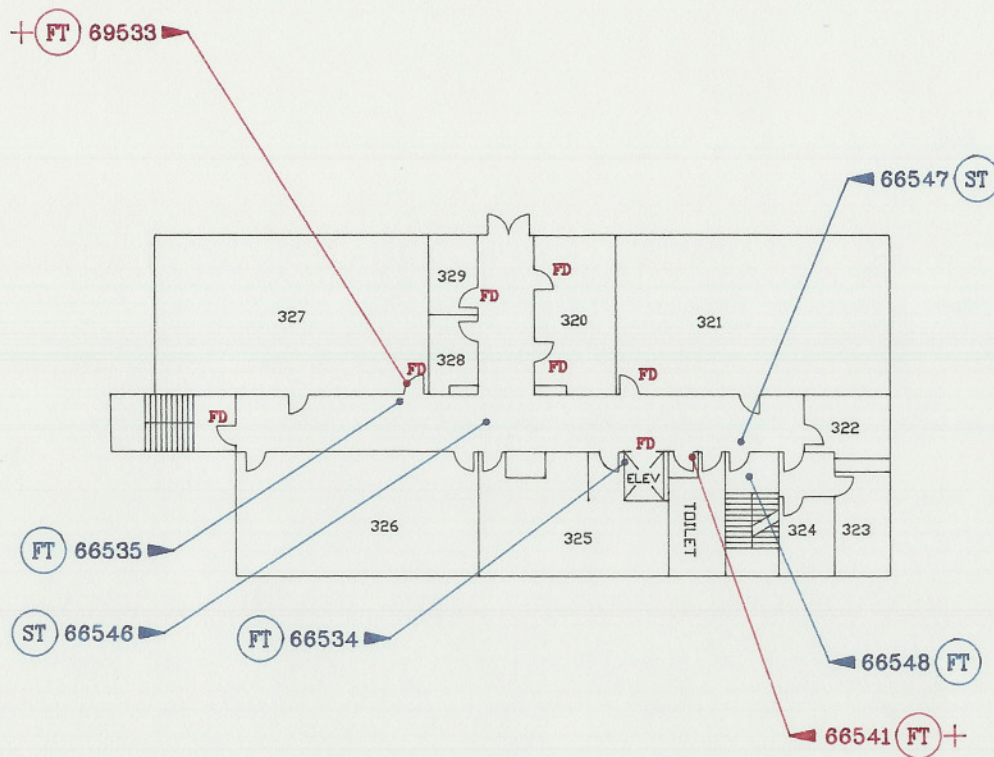

LEGEND

- (FT) FLOOR TILE
 (ST) SUSPENDED CEILING TILES
 (+) DENOTES POSITIVE RESULTS
 FD FIRE DOOR (ASSUMED TO CONTAIN ASBESTOS)

THIRD FLOOR

DYNAMAC
 CORPORATION

MONTGOMERY COLLEGE
 TAKOMA PARK CAMPUS
 ASBESTOS INVENTORY


APPROVED:

SAMPLE LOCATIONS
 BUILDING: SCISOUTH

SCALE: 1" = 30'

DATE: 03/18/91

DRAWING NO.: SSO-3S

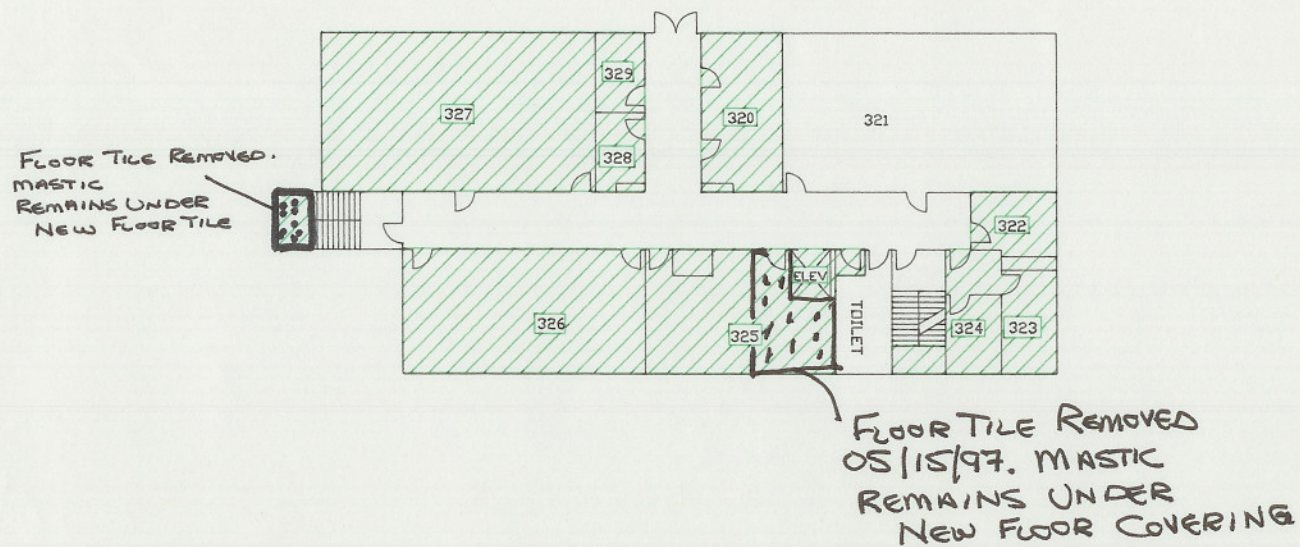

THIRD FLOOR
AREAS POSITIVE FOR FLOOR TILE
AND MASTIC (ASSUMED)

DYNAMAC
CORPORATION

MONTGOMERY COLLEGE
TAKOMA PARK CAMPUS
ASBESTOS INVENTORY

APPROVED:

SAMPLE LOCATIONS
BUILDING: SCISOUTH

SCALE: 1" = 30'

DATE: 03/18/91

DRAWING NO.: SSO-3FT